°SECTION 1

- DRAWINGS ARE PRELIMINARY AND NOT FOR CONSTRUCTION UNLESS STRUCTURAL ENGINEER'S STAMP IS AFFIXED TO DRAWINGS.
- ANY DISCREPANCIES IN THE DRAWINGS, NOTES AND SPECIFICATIONS SHALL BE REPORTED TO OWNER'S REPRESENTATIVE FOR CLARIFICATION THE CONTRACTOR SHALL VERIFY AND COORDINATE DIMENSIONS PRIOR TO PROCEEDING WITH ANY WORK OR FABRICATION.
- THE CONTRACTOR IS RESPONSIBLE FOR ALL BRACING AND SHORING DURING CONSTRUCTION.
- IV. CONTRACTOR TO SUBMIT A REQUEST TO ENGINEER/ARCHITECT FOR ANY SUBSTITUTION OF MATERIALS OR PRODUCTS SPECIFIED ON THE DRAWINGS
- V. STRUCTURAL DESIGN PER 2015 INTERNATIONAL BUILDING CODE.
- VI. ALL CONSTRUCTION TO CONFORM TO 20152 IBC.
- VII. THE FOLLOWING NOTES APPLY UNLESS SHOWN OTHERWISE VIII. THESE DRAWINGS HAVE BEEN PREPARED SOLELY FOR THE USE IN THE CONSTRUCTION OF A PROPOSED BUILDING TO WHICH THESE NOTES ARE ATTACHED. THE DRAWINGS SHALL NOT BE USED IN
- WHOLE OR IN PART. FOR FABRICATION OR CONSTRUCTION AT ANY OTHER LOCATION WITHOUT THE WRITTEN CONSENT OF THE ENGINEER

°SECTION 2

I. ROOF LOADING

PITCHED ROOF LIVE LOAD (SNOW): DEAD LOAD: 35 PSF 15 PSF TOTAL LOAD 50 PSF

- II. FLOOR LOADING LIVE LOAD: 40 PSF DEAD LOAD: 12 PSF TOTAL LOAD: 52 PSF
- III. WIND LOADING: 115 MPH. EXPOSURE C
- SEISMIC LOADING: SS = 0.6. S1 = 0.2

/2021 DESIGN SOIL PARAMETERS

1500 PSE REARING PRESSURE ASSUMED WITH 45 PCF 6/1 E.F.P. ACTIVE LATERAL EARTH PRESSURE IBC TABLE 1804.2 CLASS 4 MATERIAL(S)

SECTION 3 - CONCRETE D G

ustom

Crookston

 \odot

opyright (

GENERAL REQUIREMENTS

STRUCTURAL CONCRETE FOR FOOTING SHALL HAVE A MINIMUM 28 DAY STRUCTURAL CONCRETE FOR FOOTING SHALL HAVE A MINIMUM 2 COMPRESSIVE STRENGTH OF 2,500 PSL. CONCRETE FOR SLABS ON GRADE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AND A MAXIMUM WATER CEMENT RATIO OF 0.5. ALL OTHER CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3,000 PSI. MINIMUM CEMENT CONTENT SHALL BE ESPACYCCI VO. MAXIMUM ROTE ACCORDATE CHILL DE 2015 5 SACKS/CU. YD. MAXIMUM SIZE AGGREGATE SHALL BE 3/4", SLUMP NOT TO EXCEED 4".

IL CAST IN PLACE CONCRETE

IF SOFT, SPONGY OR WET SOILS ARE ENCOUNTERED CONSTRUCTION IS TO BE STOPPED AND ENGINEER CONTACTED IMMEDIATELY.

- A. CONCRETE FORM WORK TO BE OF ADEQUATE SIZE AND STRENGTH PROPERLY BRACED TO PREVENT SAGGING OR BULGING. PROTECT ALL CONCRETE FROM FREEZING TEMPERATURES. REFER TO DRAWING FOR DIMENSIONS OF CONCRETE MEMBERS AND SIZE AND LOCATION OF ALL REINFORCEMENT
- NO FOOTING SHALL BE PLACED ON DISTURBED SOIL (IF DISTURBED COMPACT SOIL IN 6" LIFTS TO 90% OF MAXIMUM DRY DENSITY PER ASTM D1557). FOOTINGS SHALL BE STEPPED DOWN ONE (1) VERTICALLY TO ONE AND ONE HALF (1-1/2) HORIZONTALLY
- C. FOUNDATION WALLS

E. CONCRETE SLABS

REINFORCE PER DRAWINGS. DO NOT BACKFILL WALLS UNTIL MAIN FLOOR IS FRAMED AND SHEATHED AND CONCRETE HAS CURED A A MINIMUM OF 7 DAYS. USE HAND OPERATED COMPACTION EQUIPMENT ADJACENT TO NEWLY PLACED CONCRETE BASEMENT WALLS.

- D. CONCRETE PADS AND THICKENED SLABS
- REFER TO DRAWINGS AS TO SIZE AND REINFORCEMENT

SLABS ON GRADE, AS NOTED ON THE DRAWINGS, TO BEAR ON 6" COMPACTED GRAVEL BASE. MINIMUM SLAB REINFORCEMENT TO BE #3 RE-BAR @ 18" o.c. BOTH WAYS, PLACED 1" CLEAR FROM TOP FACE (U.N.O. ON PLANS

F. FIREPLACE FOOTINGS AND CMU WALLS

MATCH HORIZONTAL REINFORCEMENT

REFER TO DRAWINGS G. REINFORCEMENT

> REINFORCEMENT SHALL BE ASTM A615, GRADE 60 FOR #5 BARS AND LARGER, GRADE 40 FOR #3 & #4 BARS, ALL REBAR LAPPED 30 TIMES DIANCER, READ AT FOOTINGS TO HAVE 3" CLEAR COVER OF CONCRETE (U.N.O. ON DRAWINGS). PROVIDE CORNER BARS WITH 18" LEGS AT THE CORNERS OF ALL WALLS AND FOOTINGS, SIZE AND PLACEMENT TO

H. °ANCHOR BOLTS

ANCHOR BOLTS TO BE ASTM A307, 1/2" DIA: x 10" EMBEDDED IN FOUNDATION WALLS @ 2'-8" o.c. (MAX) U.N.O. (SEE FOUNDATION PLAN FOR REQUIREMENTS AT SHEARWALLS). BOLTS TO BE WITHIN 1'-0" OF ENDS OF SILL PLATES (COORDINATE WITH GENERAL CONTRACTOR). MINIMUM OF TWO ANCHOR BOLTS PER SILL PLATE

ALL POSTS SUPPORTED BY ISOLATED FOOTINGS TO HAVE POST ANCHORS UNLESS BRACED IN STUD WALLS.

REFER TO DRAWINGS FOR HOLDDOWN REQUIREMENTS. INSTALL REQUIRED EMBEDDED ITEMS PER MANUFACTURER'S CATALOG TO ENGAGE HOLDDOWNS

CONSTRUCTION AND CRACK CONTROL JOINTS

ALL SURFACES OF CONSTRUCTION JOINTS SHALL BE CLEANED TO REMOVE DUST, CHIPS AND OTHER FOREIGN MATERIAL PRIOR TO PLACING ADJACENT CONCRETE. CRACK CONTROL JOINTS IN SLABS SHALL HAVE A MAXIMUM SPACING OF 15'-0" IN BOTH DIRECTIONS. THE CONTRACTOR SHALL SUBMIT THE DETAILS AND PROPOSED LOCATIONS OF CONSTRUCTION JOINTS AND CRACK CONTROL JOINTS FOR REVIEW BEFORE STARTING CONSTRUCTION

- copyright © Crookston Custom Designs 6/11/2021
- I VAPOR BARRIER
- VAPOR BARRIER TO BE 4 MIL POLYETHYLENE SHEET PLACED ON UNDISTURBED SOIL. VAPOR BARRIER UNDER SLAB ON GRADE, IF REQUIRED, PLACED ON COMPACTED GRAVEL WITH 1" OF DAMP SAND BETWEEN POLYETHYLENE VAPOR BARRIER AND CONCRETE
- K. EMBEDDED ITEMS FOR HD TYPE HOLDDOWNS TO BE ASTM A307 HEX HEADED BOLT IN THE DIAMETER AS SPECIFIED BY THE MANUFACTURER FOR THE HD ALL BOLTS TO HAVE 3" MIN CONCRETE SIDE COVER FOR THE HU, ALL BOLTS TO FAVE 3 MIN. CONCRETE SIDE COVER. EMBEDDMENT DEPTHS ARE 15° FOR BOLTS UP TO AND INCLUDING 1° DIA., 24° DEPTH FOR BOLTS OVER 1°. TYPICAL REINFORCEMENT TO PASS UNINTERRUPTED ALONGSIDE HOLDDOWN AS APPLICABLE. COUPLER NUTS MAY BE USED TO EXTEND THE HOLDDOWN ANCHOR THROUGH THE FLOOR PLATE TO THE SHEAR WALL CHORD.

III. °EPOXY ANCHORS

EPOXY GROUTED ANCHORS, IF USED, SHALL CONFORM TO HILTI HIT OR HILTI HVA EPOXY SYSTEM OR ENGINEER APPROVED EQUIVALENT INSTALL PER MANUFACTURER'S INSTRUCTIONS. WIRE BRUSH AND BLOW OUT HOLES

°SECTION 4 - REINFORCED CONCRETE MASONRY UNITS (CMU)

I. GENERAL REQUIREMENTS

- HOLLOW CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90, GRADE N WITH A MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI (MASONRY FM=1500 PSI). USE TYPE M MORTAR WITH A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 2500 PSI. GROUT SHALL BE A PEA GRAVEL CONCRETE WITH A 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI AND A MINIMUM SLUMP OF 6 INCHES.
- INSTALL CMU OF SIZE AND ARCHITECTURAL TYPE SPECIFIED. REINFORCE PER DRAWINGS. SOLID GROUT ALL CELLS BELOW GRADE, ALL REINFORCED CELLS, AND AS SPECIFIED IN DRAWINGS. ALL & CMU AT FIREPLACES TO BE SOLID GROUTED. MAXIMUM HEIGHT FOR GROUT LIFTS TO BE 4-0" UNLESS CLEAN OUTS ARE USED.
- C. MASONRY WALLS TO BE LAID IN RUNNING BOND. REINFORCE THE WALLS HORIZONTALLY WITH (2) #4 BAR IN AN 8" HIGH BOND BEAM AT EACH FLOOR AND ROOF LEVEL. AT THE TOP AND BOTTOM OF WALLS. AND FLOOR AND ROOF LEVEL, AT THE TOP AND BOTTOM OF WALLS, AND @ 4*0* o.c. (MAX) BETWEEN, REINFORCE THE WALLS VERTICALLY WITH (1) #5 @ 4-0* o.c. (MAX) FOR FULL HEIGHT OF THE WALL, PLUS ONE #5 VERTICAL AT EACH JAMB, CORNER AND DISCONTINUOUS END (U.N.O. ON DRAWINGS) LAP REINFORCEMENT 40 BAR DIAMETERS AT SPLICES. REFER TO DRAWINGS FOR LINTEL DETAILS AT FIREPLACES.
- D. PROVIDE DOWELS WITH STANDARD HOOKS BETWEEN FOUNDATIONS AND ALL CMU, DOWELS DRILLED AFTER THE FACT ARE NOT ACCEPTABLE UNLESS APPROVED BY THE ENGINEER. SIZE AND SPACING OF DOWELS TO MATCH VERTICAL REINFORCEMENT OF CMU. DOWELS TO PROJECT A MINIMUM OF 2'-0' INTO CMU AND 17 BAR DIAMETERS INTO FOUNDATION
- II. VENEER ANCHORAGE

PROVIDE VENEER ANCHORAGE PER IBC 3006(D)1. ANCHOR TIES TO BE NOT LESS THAN 9 GA. GAI VANIZED WIRE OR 22 GA. BY 1" GAI VANIZED NOT LESS THATE 9GA, GALCHARLED WIRE OR 22 GALCH T GALCHARLED SHEET METAL. ANCHOR TIES SHALL BE SPACED NOT MORE THAN 24" o.c. AND SUPPORT NO MORE THAN 2 SQ. FEET OF VENEER. TIES SHALL BE PROVIDED TO HORIZONTAL JOINT REINFORCEMENT WIRE OF 9 GA. OR EQUIVALENT. JOINT REINFORCEMENT TO BE CONTINUOUS WITH BUT SPLICES BETWEEN TIES.

°SECTION 5 - FRAMING LUMBER

- SAWN STRUCTURAL LUMBER
- A. SAWN LUMBER SHALL BE DOUGLAS FIR-LARCH (DF-L) NO. 2 OR BETTER FOR ALL 2 INCH AND 4 INCH NOMINAL LUMBER AND DF-L NO. 1 OR BETTER FOR 6 INCH NOMINAL AND LARGER STRUCTURAL MEMBERS (U.N.O.)
- B. WOOD BEARING ON OR INSTALLED WITHIN 1" OF MASONRY OR CONCRETE SHALL SSURE TREATED WITH AN APPROVED PRESERVATIVE PROVIDE MILD STEEL PLATE WASHERS AT ALL BOLT HEADS AND NUTS BEARING ON WOOD.
- ALL FRAMING DETAILS SHALL BE IN ACCORDANCE WITH CHAPTER 23 OF THE 2006 EDITION, UNLESS OTHERWISE NOTED ON THE DRAWINGS. ALL FRAMING NAILING SHALL CONFORM TO TABLE 2304.9.1 OF THE IBC UNLESS OTHERWISE SHOWN. PROVIDE STEEL STRAPS AT PIPES IN STUD WALLS AS REQUIRED BY IBC CHAPTER 23. PLUMBING AND ELECTRICAL RUNS IN STUD WALLS SHAL IBC CHAPTER 23. PLUMBING AND ELECTRICAL RUNS IN STUD WALLS SHALL CONFORM TO CHAPTER 23. BOLTS SHALL BE STANDARD MACHINE BOLTS (A307). ALL NAILS SHALL BE COMMON WIRE OR GALVANIZED BOX NAILS. IF PNEUMATIC NAILERS ARE TO BE USED, CONTRACTOR MUST SUBMIT A SCHEDULE OF NAILS DESIRED AS SUBSTITUTION TO THE ARCHITECT OR ENGINEER FOR REVIEW. A CHANGE IN THE NUMBER OF NAILS OR A CLOSER NAIL SPACING MAY PC DECOURDED. BE REQUIRED.
- D. METAL HANGERS AND CONNECTORS SHALL BE FULLY NAILED OR BOLTED UNLESS OTHERWISE NOTED ON THE DRAWINGS. METAL HANGERS OR CONNECTORS SHOWN ON THE DRAWINGS SHALL BE MANUFACTURED BY SIMPSON COMPANY SHOWN ON THE DRAWINGS SHALL BE MANDFACTORED BY MIMSON COMPANY. METAL HANGERS OR CONNECTORS BY OTHER MANUFACTURES MAY BE CONSIDERED WHERE LOAD CAPACITY AND DIMENSIONS ARE EQUAL OR BETTER. ALL SUBSTITUTIONS MUST BE SUBMITTED TO THE ENGINEER FOR REVIEW.
- PROVIDE SOLID BLOCKING BELOW ALL BEARING WALLS. PROVIDE SOLID VERTICAL BLOCKING IN FLOOR SPACE TO MATCH STUD BUNDLE OR SOLID COLUMN ABOVE AND BELOW. VERTICAL BLOCKING AT WOOD "I" JOISTS SHALL BE 1/16" LONGER THAN JOIST IS DEEP. MINIMUM POST TO BE TWO 2x STUDS BEARING AT EACH END OF HEADER U.N.O. FOR BEAMS FRAMING PERPENDICULAR TO BEARING WALLS END OF HEADER U.N.O. FOR BEAMS FRAMING PERPENDICULAR TO BEARING WAI PROVIDE FULL WIDTH BEAM POCKET WITH FILLER AS REQUIRED AND KING STUD BOTH SIDES. STITCH STUD BUNDLES TOGETHER WITH 16d COMMON @ 18" o.c. MAXIMUM (U.N.O.) WHERE FLOOR BEAMS ARE FRAMED FLUSH WITHIN FLOOR AND TOP FLANGE HANGERS ARE SPECIFIED, BEAMS ARE TO BE BLOCKED UP TO JOIST HEIGHT WITH FULL WIDTH DF-L SPACER AS REQUIRED.
- II. STRUCTURAL GLUED-LAMINATED TIMBER
- ALL GLUED-LAMINATED TIMBER SHALL BE COMBINATION 24F-V4 FOR SIMPLY SUPPORTED BEAMS, COMBINATION 24F-V8 FOR BEAMS CONTINUOUS OVER SUPPORTS, AND COMBINATION 12 FOR COLUMNS (U.N.O.) FABRICATION TO BE IN ACCORDANCE WITH AITC 117. PROVIDE WET-USE ADHESIVES. MAXIMUM MOISTURE CONTENT SHALL BE 15%. PROVIDE MILD STEEL PLATE WASHERS AT ALL BOLT HEADS AND NUTS BEARING ON WOOD. WOOD BEARING, ON BUTHING TO BEARING ON WOOD. WOOD BEARING ON OR WITHIN 1" OF MASONRY OR CONCRETE SHALL BE TREATED WITH AN APPROVED PRESERVATIVE. SEAL END GRAIN OF ALL EXTERIOR. EXPOSED BEAMS INCLUDING NON-LOAD BEARING ARCHITECTURAL BEAMS
- III. MANUFACTURED WOOD "I" JOISTS


WOOD "I" JOISTS AS MANUFACTURED BY THE TRUS JOIST MacMILLAN CORPORATION SHALL BE DESIGNED AND CERTIFIED BY MANUFACTURER TO SUPPORT LOADINGS AS SHOWN ON THE DRAWINGS. SUBSTITUTION OF PRODUCTS BY OTHER MANUFACTURERS REQUIRES APPROVAL OF ENGINEER OF RECORD. JOISTS SHALL BE ERECTED, INSTALLED, AND BRACED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS


IV. LAMINATED VENEER LUMBER (LVL)

PRODUCTS SPECIFIED HEREIN AS ML OR M=L AND PL SHALL CONFORM TO THE PERFORMANCE CRITERIA OF LVL AND PSL PRODUCTS AS MANUFACTURED BY TRUSS JOIST MacMILLAN AS MICROLLAM AND PARALLAM. SUBSTITUTES ARE ACCEPTABLE PROVIDED THEY HAVE THE SAME STRUCTURAL VALUES AS ML AND PL. ANY SUBSTITUTIONS MUST BE SUBMITTED TO THE ENGINEER FOR REVIEW

Page Table		
Number	Title	
1	Cover Page	
2	Main Floor Plan	
3	Foundation Plan	
4	Basement Plan	
5	Front & Right Elevations	
6	Back & Left Elevations	
7	Sections & Details	
8	Nailing Schedule	
9	Framing Plans	
10	Plot Plan	

Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

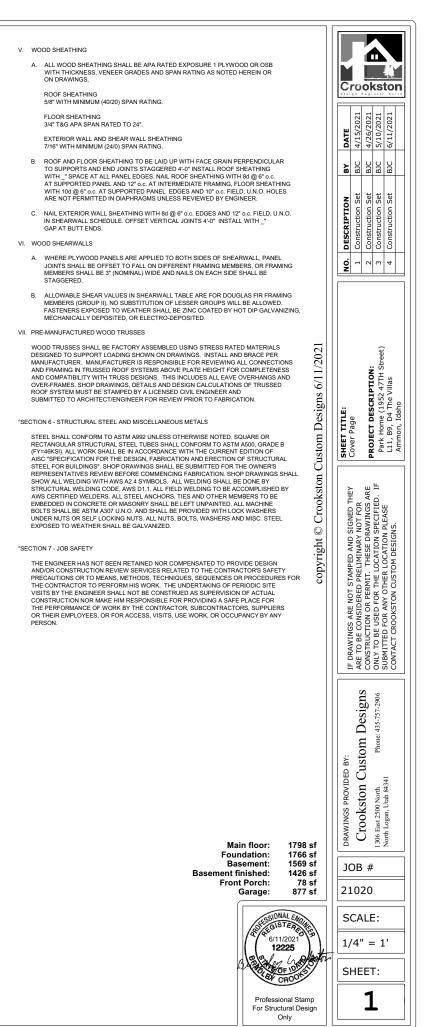


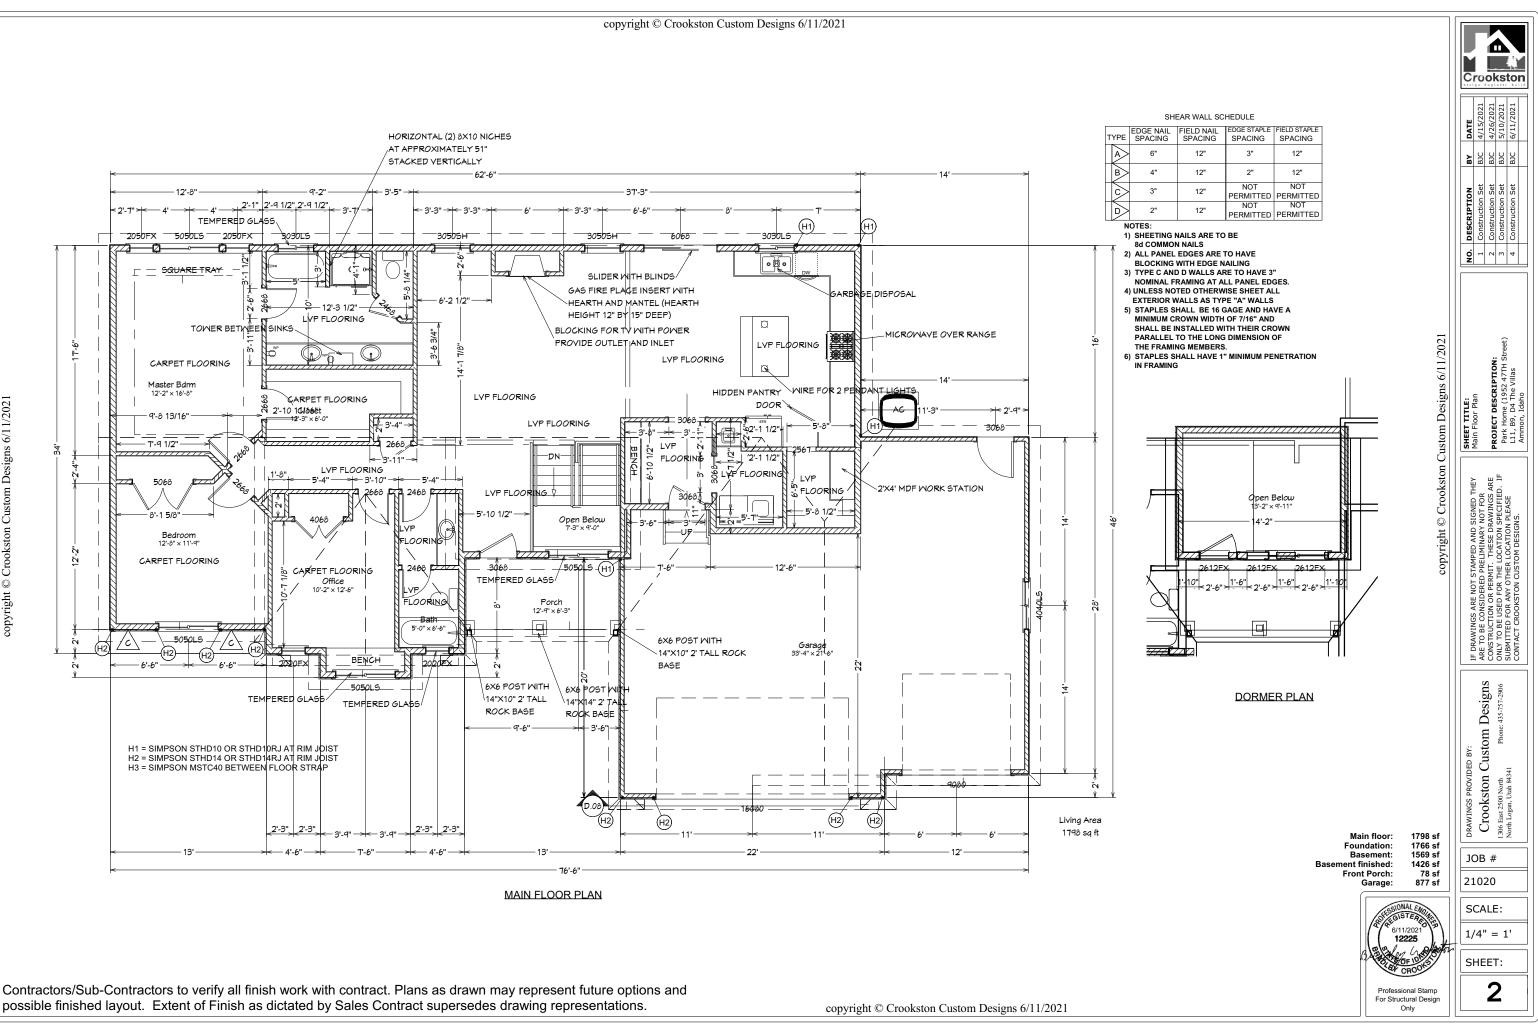

possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

Crookston Custom Designs 6/11/2021

sopyright © (

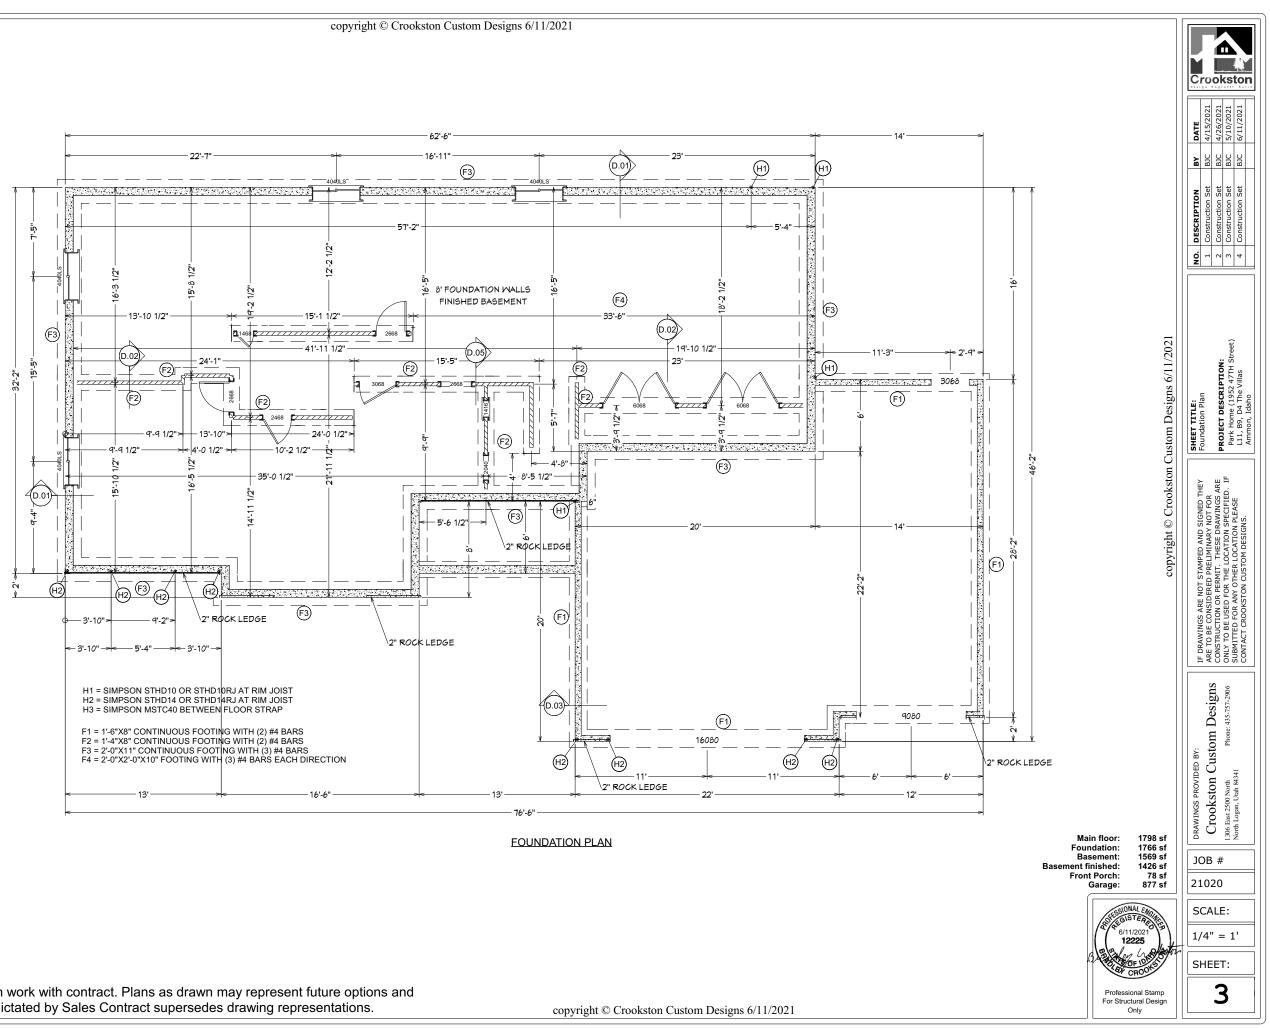

copyright © Crookston Custom Designs 6/11/2021


Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.


62'-6 48'-6" 10'-8' (D.01) (H1) 4040L5 13'-0 1/2 ٦Û ® ® GAS FIRE PLACE INSERT WITH 2 60 HEARTH AND MANTEL (HEARTH Bedroom 12'-5" × 11'-0" 3'-10 1/2" 7 1/2" Bedroom 12'-8" × 12'-9" HEIGHT 12" BY 15" DEEP) CARPET FLOORING CARPET FLOORING <u>9</u>-1 8' FOUNDATION WALLS 2'-0 1/2" FINISHED BASEMENT å -32'-8 1/2 2668 🛃 ® Ø R Ø (D.05) ARCHED OPENING 6068 2868 272 3068 4'-4 1/2" 3'-1 1/2" 6068 6068 CARPET FLOORING -9 1/2 'n =3'-6"= -3'-6"-KIDS ROOM 5'-0" × " SMALL KIDS KIDS TILE Bedroom 12'-8" × 14'-8" DOOR MINDOM FLOORING (D.01 (H1)5'-0 1/2" 7'-2 1/2' ÷2'≯ 2" ROCK LEDGE 5'-5' (H2) (H2) 2" ROCK LEDGE 2" ROCK LEDGE H1 = SIMPSON STHD10 OR STHD10RJ AT RIM JOIST H2 = SIMPSON STHD14 OR STHD14RJ AT RIM JOIST H3 = SIMPSON MSTC40 BETWEEN FLOOR STRAP (D.03)-16080 (H2 (H2) 2" ROCK LEDGE 22 76'-6' **Basement Plan** Garage Area 877 5 so # sf FINISHED BASEMENT AREA


copyright © Crookston Custom Designs 6/11/2021

Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

copyright © Crookston Custom Designs 6/11/2021

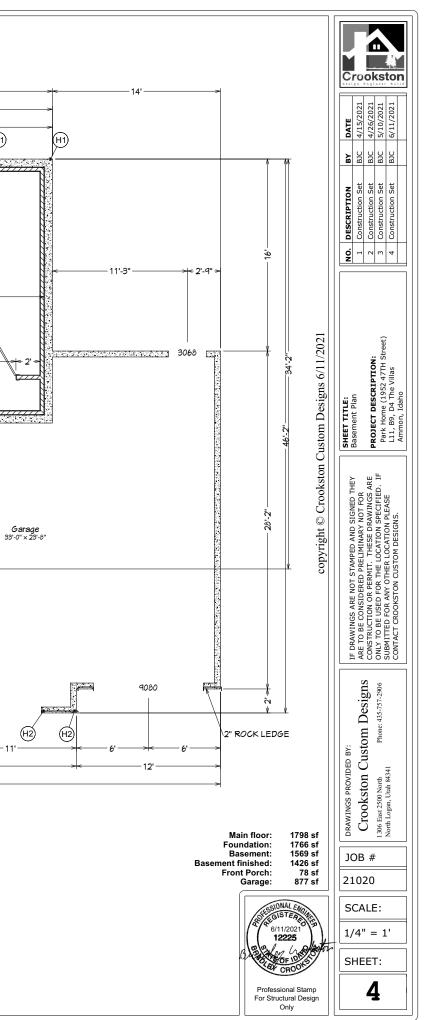

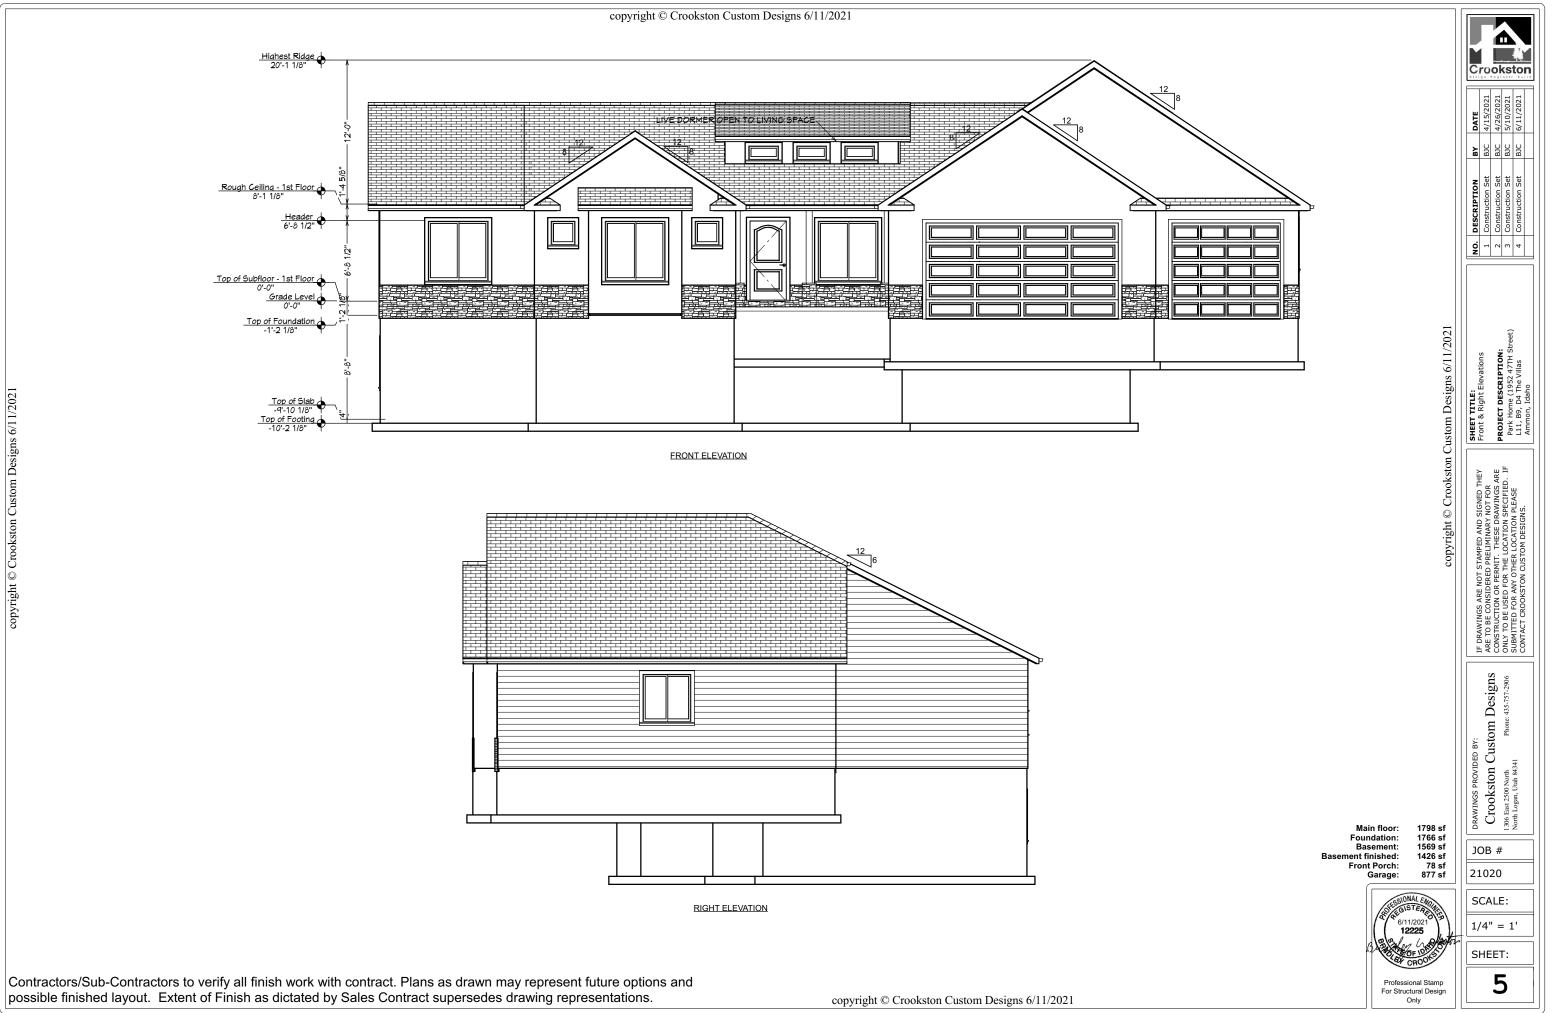


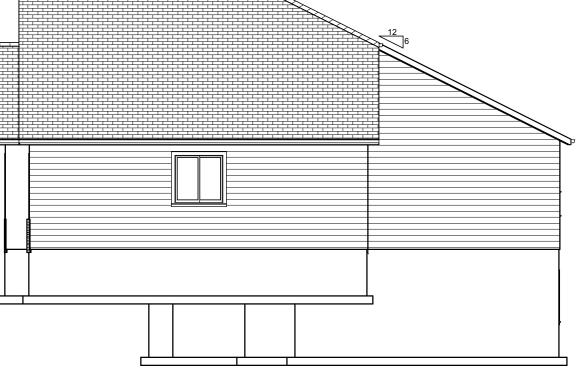


Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.




Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

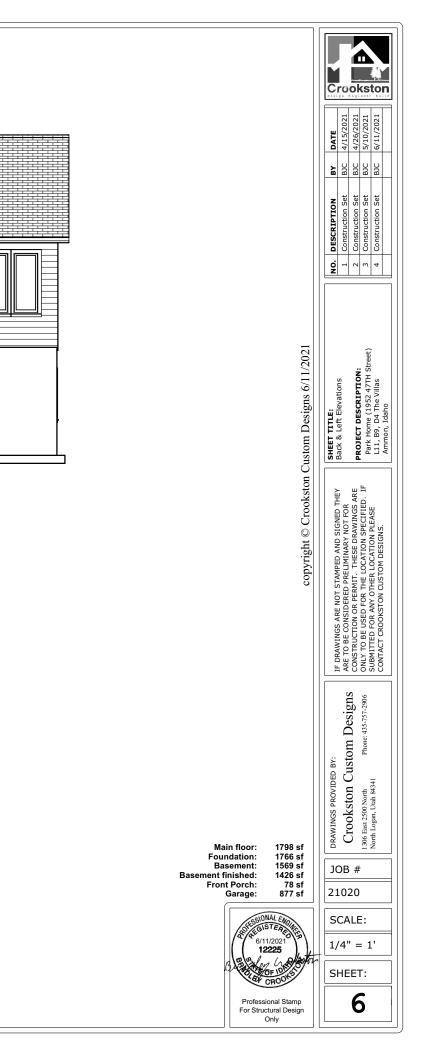

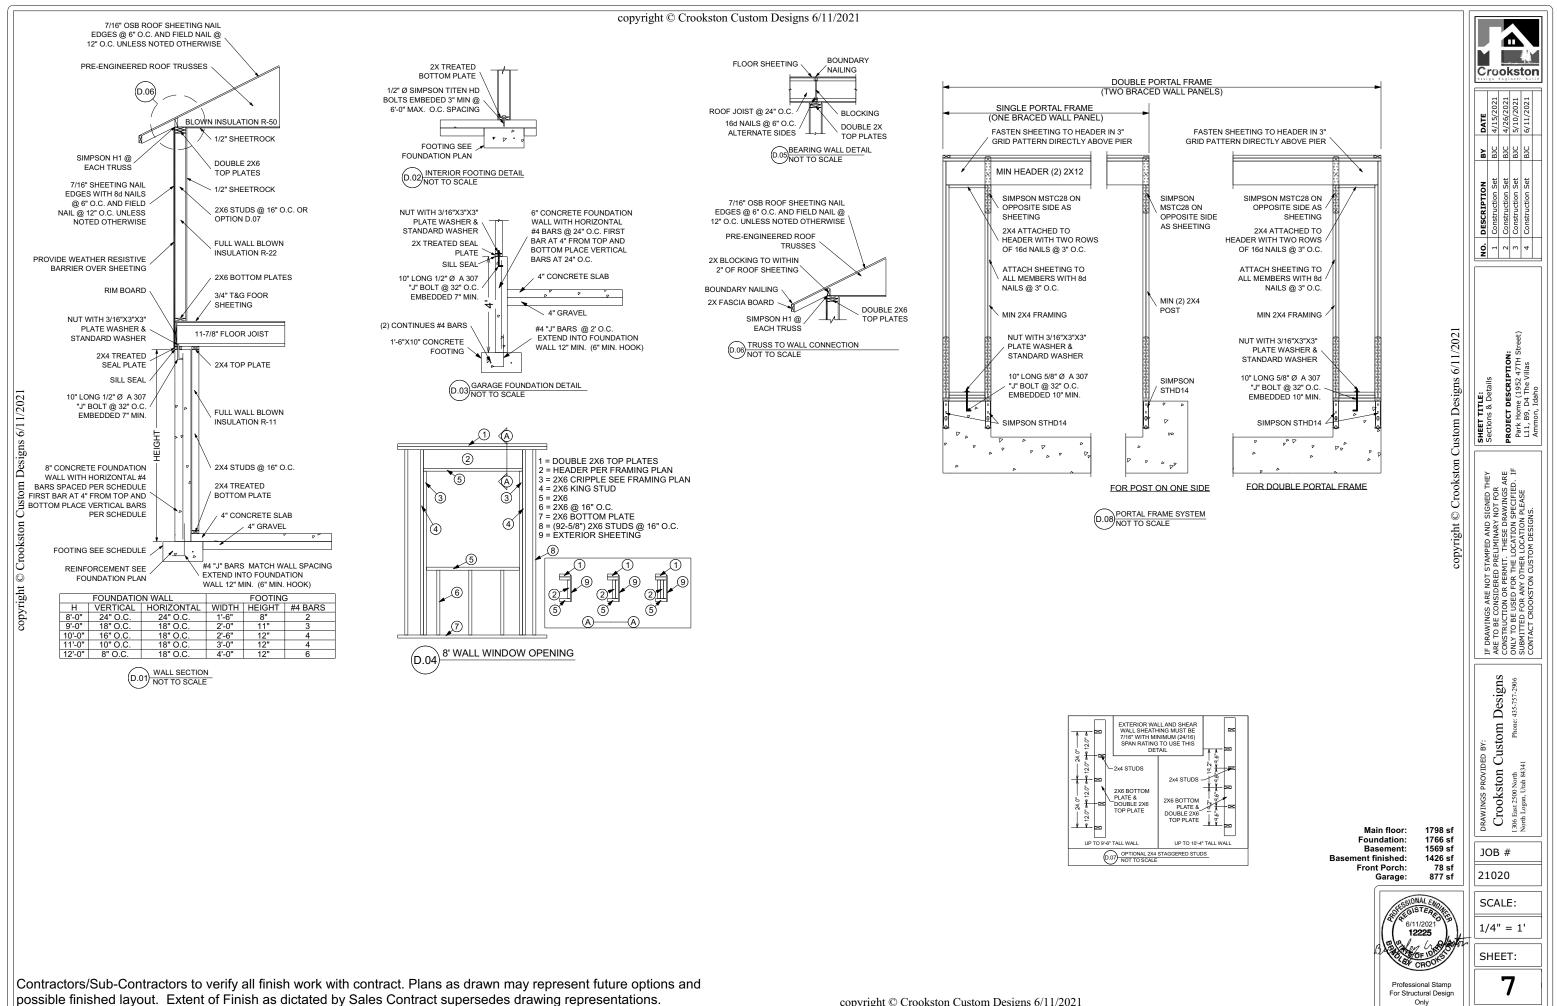

copyright © Crookston Custom Designs 6/11/2021

PLAN SYMBOLS

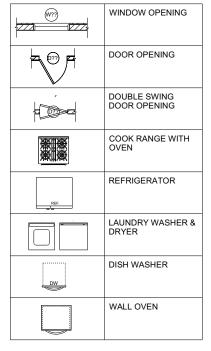



CONNECTION	FASTENING (a), (m)	LOCATION
1. Joist to sill or girder	3 - 8d common (2-1/2" × 0.131")	toenail
	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
2. Bridging to joist	2 - 8d common (2-1/2" × 0.131")	toenail each end
	2 - 3" × 0.131" nails	
	2 - 3" 14 gage staples	
3. 1" × 6" subfloor or less to each joist	2 - 8d common (2-1/2" × 0.131")	face nail
4. Wider than 1" × 6" subfloor to each joist	3 - 8d common (2-1/2" × 0.131")	face nail
5. 2" subfloor to joist or girder	2 - 16d common (3-1/2" × 0.162")	blind and face nail
6. Sole plate to joist or blocking	16d (3-1/2" × 0.135 ") at 16" o.c.	typical face nail
	3" × 0.131" nails at 8" o.c.	typical lace han
Sole plate to joist or blocking at braced	3" 14 gage staples at 12" o.c.	
Wall panel	3- 16d (3-1/2" × 0.135") at 16" o.c.	braced wall panels
	4 - 3" × 0.131" nails at 16" o.c.	braceu wali parieis
	4 - 3" 14 gage staples at 16" o.c.	
7. Top plate to stud	2 - 16d common (3-1/2" × 0.162")	end nail
	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
8. Stud to sole plate	4 - 8d common (2-1/2" × 0.131")	toenail
	4 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
	2 - 16d common (31/2" × 0.162")	end nail
	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
9. Double studs	16d (3-1/2" × 0.135") at 24" o.c.	face nail
	3" × 0.131" nail at 8" o.c.	
	3" 14 gage staple at 8" o.c.	-
10. Double top plates	16d (3-1/2" × 0.135") at 16" o.c.	typical face nail
TO: Double top plates	3" × 0.131" nail at 12" o.c.	typical lace fiall
	3" 14 gage staple at 12" o.c.	-
Double top plates		lan ankar
	8 - 16d common (3-1/2" × 0.162")	lap splice
	12 - 3" × 0.131" nails	-
	12 - 3" 14 gage staples	
11. Blocking between joists or rafters to top	3 - 8d common (2-1/2" × 0.131")	toenail
plate	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
12. Rim joist to top plate	8d (2-1/2" × 0.131") at 6" o.c.	toenail
	3" × 0.131" nail at 6" o.c.	
	3" 14 gage staple at 6" o.c.	
13. Top plates, laps and intersections	2 - 16d common (3-1/2" × 0.162")	face nail
	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
14. Continuous header, two pieces	16d common (3-1/2" × 0.162")	16" o.c. along edge
15. Ceiling joists to plate	3 - 8d common (2-1/2" × 0.131")	toenail
33	5 - 3" × 0.131" nails	
	5 - 3" 14 gage staples	
16. Continuous header to stud	4 - 8d common (2-1/2" × 0.131")	toenail
17. Ceiling joists, laps over partitions	3 - 16d common (3-1/2" × 0.162") min.,	face nail
(see Section 2308.10.4.1, Table 2308.10.4.1)	Table 2308.10.4.1	
	4 - 3" × 0.131" nails	4
	4 - 3" 14 gage staples	4
40. Opilian inista ta angellal seftana	8 8 1	f
18. Ceiling joists to parallel rafters (see Section 2308.10.4.1, Table 2308.10.4.1)	3 - 16d common (3-1/2" × 0.162") minimum,	lace nall
(See Section 2300.10.4.1, Table 2308.10.4.1)	Table 2308.10.4.1	4
	4 - 3" × 0.131" nails	-
	4 - 3" 14 gage staples	
19. Rafter to plate	3 - 8d common (2-1/2" × 0.131")	toenail
(see Section 2308.10.1, Table 2308.10.1)	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	

FASTENING SCHEDULE

CONNECTION	FASTENING (a), (m)	L
20. 1" diagonal brace to each stud and plate	2 - 8d common (2-1/2" × 0.131")	face
	2 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
21. 1" × 8" sheathing to each bearing	3 - 8d common (2-1/2" × 0.131")	face
22. Wider than 1" × 8" sheathing to each bearing	3 - 8d common (2-1/2" × 0.131")	face
23. Built-up corner studs	16d common (3-1/2" × 0.162")	24″
	3″ × 0.131″ nails	16″
	3" 14 gage staples	16″
24. Built-up girder and beams	20d common (4" × 0.192") 32" o.c.	face
	3" × 0.131" nail at 24" o.c.	_
	3" 14 gage staple at 24" o.c.	6
	2 - 20d common (4" × 0.192")	face
	3 - 3" × 0.131" nails 3 - 3" 14 gage staples	-
25. 2" planks	16d common (3-1/2" × 0.162")	at e
25. 2 planks 26. Collar tie to rafter	3 - 10d common (3" × 0.162)	face
	4 - 3" × 0.131" nails	lace
	4 - 3" 14 gage staples	-
27. Jack rafter to hip	3 - 10d common (3" × 0.148")	toe
	4 - 3" × 0.131" nails	.00
	4 - 3" 14 gage staples	-
	2 - 16d common (3-1/2" × 0.162")	face
	3 - 3" × 0.131" nails	-
	3 - 3" 14 gage staples	
28. Roof rafter to 2-by ridge beam	2 - 16d common (3-1/2" × 0.162")	toe
, C	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
	2 -16d common (3-1/2" × 0.162")	face
	3 - 3" × 0.131" nails	
	3 - 3" 14 gage staples	
29. Joist to band joist	3 - 16d common (3-1/2" × 0.162")	face
	4 - 3" × 0.131" nails	
	4 - 3" 14 gage staples	
30. Ledger strip	3 - 16d common (3-1/2" × 0.162")	face
	4 - 3" × 0.131" nails	_
	4 - 3" 14 gage staples	
31. Wood structural panels and particleboard (b)	1/2" and less	6d (
Subfloor, roof and wall sheathing (to framing)		2-3
		1-3
	19/32" to3/4"	8d
		2-3
Cingle floor (combination subfloor underloyment to		2″ 1
Single floor (combination subfloor-underlayment to framing)		
nannig)	7/8" to 1"	8d
	11/8" to 11/4"	10c
	3/4" and less	6d
	7/8" to 1"	8d
	11/8" to 11/4"	10c
32. Panel siding (to framing)	1/2" or less	6d (
	5/8"	8d
33. Fiberboard sheathing (g)	1/2"	No.
		6d (
		No.
	25/32"	No.
		8d (
		No.
34. Interior paneling	1/4" 3/8"	4d (6d (

a. Common or box nails are permitted to be used except where otherwise stated.
b. Nails spaced at 6 inches on center at edges, 12 inches at intermediate supports except 6 inches at supports where spans are 48 inches or more. For nailing of wood structural panel and particleboard diaphragms and shear walls, refer to Section 2305. Nails for wall sheathing are permitted to be common, box or casing.
c. Common or deformed shank (6d - 2" × 0.113"; 8d - 21/2" × 0.131"; 10d - 3" × 0.148").
d. Common (6d - 2" × 0.113"; 8d - 21/2" × 0.131"; 10d - 3" × 0.148").
e. Deformed shank (6d - 2" × 0.113"; 8d - 21/2" × 0.131"; 10d - 3" × 0.148").
f. Corrosion-resistant siding (6d - 17/8" × 0.106"; 8d - 23/8" × 0.128") or casing (6d - 2" × 0.099"; 8d - 21/2" × 0.113") nail.
g. Fasteners spaced 3 inches on center at exterior edges and 12 inches on center at intermediate supports, when used as structural sheathing. Spacing shall be 6 inches on center on the edges and 12 inches on center at intermediate supports for nonstructural

applications. . Corrosion-resistant roofing nails with 7/16-inch-diameter head and 1-1/2-inch length for 1/2-inch sheathing and 1-3/4-inch length for 25/32 inch sheathing. Corrosion-resistant staples with nominal 7/16-inch crown or 1-inch crown and 1for 25/32-inch sheathing. Panel supports at 16 inches (20 inches if strength axis marked).


j. Casing (1-1/2" × 0.080") or finish (1-1/2" × 0.072") nails spaced 6 inches on pan k. Panel supports at 24 inches. Casing or finish nails spaced 6 inches on panel edg l. For roof sheathing applications, 8d nails (21/2" × 0.113") are the minimum requir m. Staples shall have a minimum crown width of 7/16 inch.


n. For roof sheathing applications, fasteners spaced 4 inches on center at edges, 8
 o. Fasteners spaced 4 inches on center at edges, 8 inches at intermediate support
 at edges, 6 inches at intermediate supports for roof sheathing.

p. Fasteners spaced 4 inches on center at edges, 8 inches at intermediate support

Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

			Crookston
LOCATION			Þesign Engineer build
e nail			DATE 4/15/2021 4/26/2021 5/10/2021 6/11/2021
e nail			DATE 4/15/2 4/26/2 5/10/2 6/11/2
e nail ' o.c.			
' 0.C.			
e nail at top and bottom staggered on opposite sides			DESCRIPTION Construction Set Construction Set Construction Set Construction Set
e nail at ends and at each splice			
each bearing			N 1 2 8 4
e nail			
nail			
e nail		1/2021	V: Street)
nail		copyright © Crookston Custom Designs 6/11/202	SHEET TITLE: Nailing Schedule PROJECT DESCRIPTION: Park Home (1952 47TH Street) L11, B9, D4 The Villas Ammon, Idaho
e nail		Desig	HEET TITLE: Nailing Schedule PROJECT DESCRIPTIO Park Hone (1952 4717 L11, B9, D4 The Villas Ammon, Idaho
e nail		Custom	SHEET Nailing PROJE Park L11, Amm
e nail at each joist		kston (IF IF
(c), 1		loo	VED TI FOR INGS /
//8" × 0.113" nail (n)		0	IF DRAWINGS ARE NOT STAMPED AND SIGNED THEY BET DB E CONSIDERED PRELIMINARY NOT FOR CONSTRUCTION OR PREMIT. THESE DRAWINGS ARE ONLY TO BE USED FOR THE LOCATION SPECIFIED. If SUBMITTED FOR ANY OTHER LOCATION PLEASE CONTACT CROOKSTON CUSTOM DESIGNS.
3/4" 16 gage (o)		ight	D ANE IINAR IESE C ATION DESIO
(d) or 6d (e) b/8" × 0.113" nail (p)		ıydc	AMPEI RELIN I. TH LOC.
16 gage staple (p)		ğ	N CUS
(c)			RE NC SIDER OR PI OR PI KSTOI
d (d) or 8d (e)			GS AI CONS TION E USE E USE
(e) (e)			WIN D BE O BE C D BE CT C
d (d) or 8d (e)			DRA DRA DNST DNST JBMI JBMI DNTA
(f) (f)			
. 11 gage roofing nail (h)			° IS
common nail (2" × 0.113") . 16 gage staple (i)			om Designs
. 11 gage roofing nail (h)			Des B35-75
common nail (2-1/2" × 0.131")			n I
. 16 gage staple (i) (j)			tor
(k)			(ns
			VIDI 1 (1) 84341
			PRC StO Utah
1/4-inch length for 1/2-inch sheathing and 1-inch length in the long direction of the panel, unless otherwise	1		DRAWINGS PROVIDED BY: Crookston Custom Designs 1306 East 2500 North Phone: 435-757-2906 North Logan, Utah 84341
el edges, 12 inches at intermediate supports. ges, 12 inches at intermediate supports.	Main floor: Foundation:	1798 sf 1766 sf	D S S
red for wood structural panels.	Basement:	1569 sf	JOB #
B inches at intermediate supports. is for subfloor and wall sheathing and 3 inches on cent	Front Porch: Garage:	1426 sf 78 sf 877 sf	21020
S.		AL ENGI	SCALE:
	2 9 9 6/11	/2021	1/4" = 1'
	G Est	225 (, SHEET:
		ROO!	
	For Struct	onal Stamp tural Design Only	8

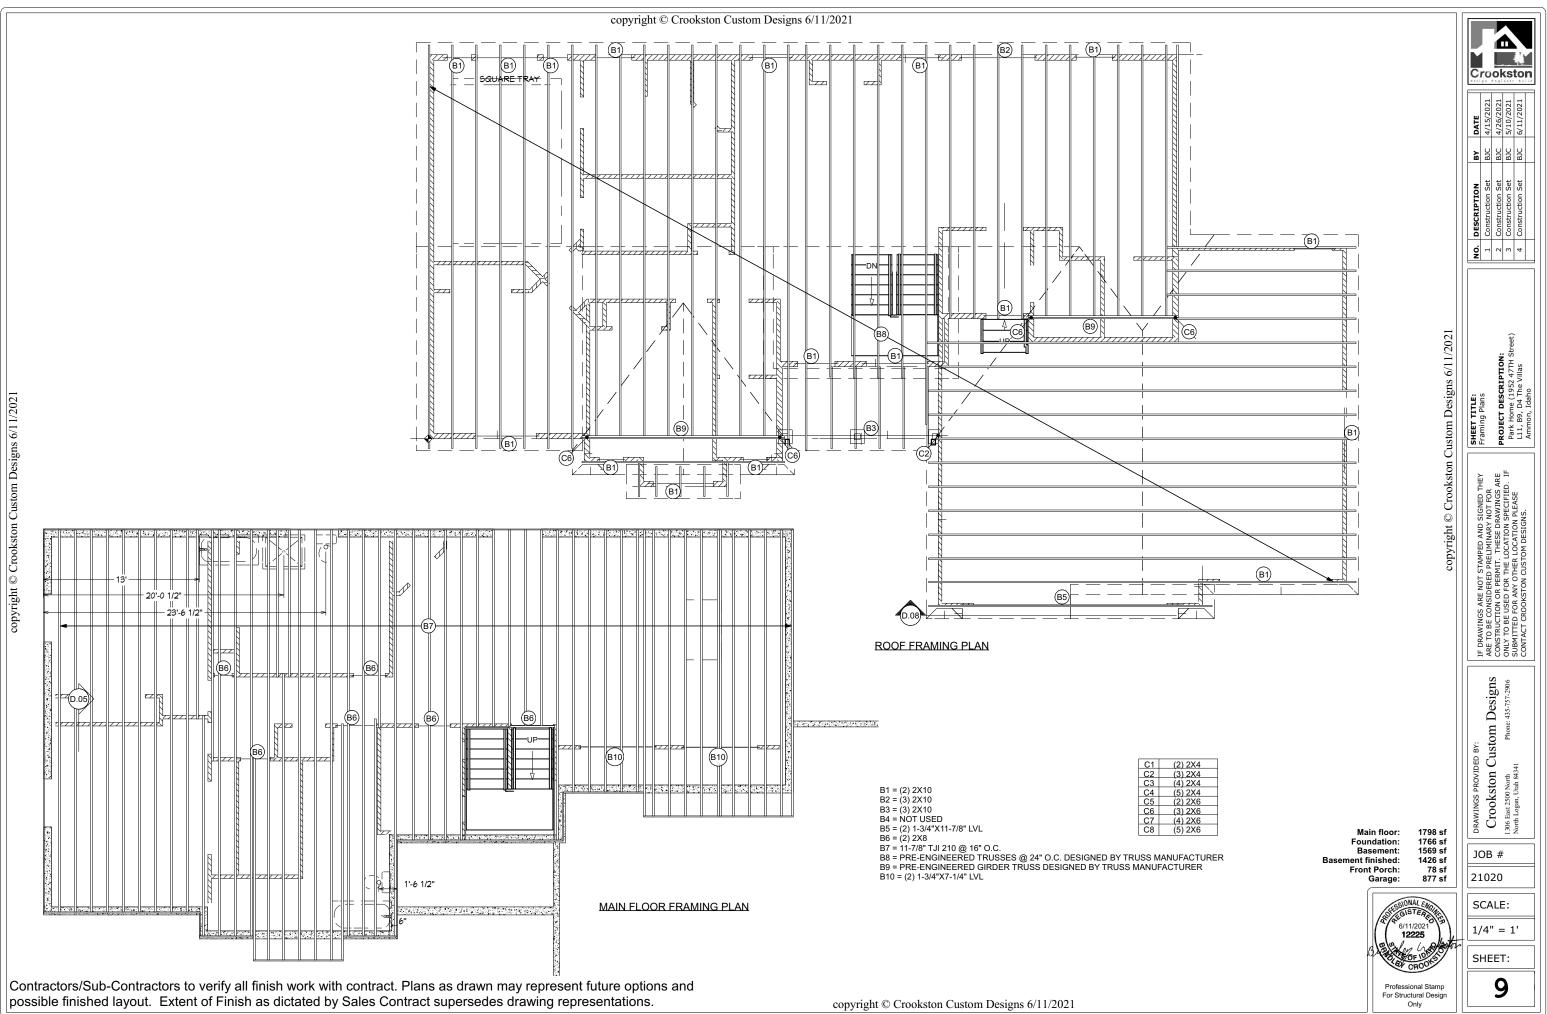

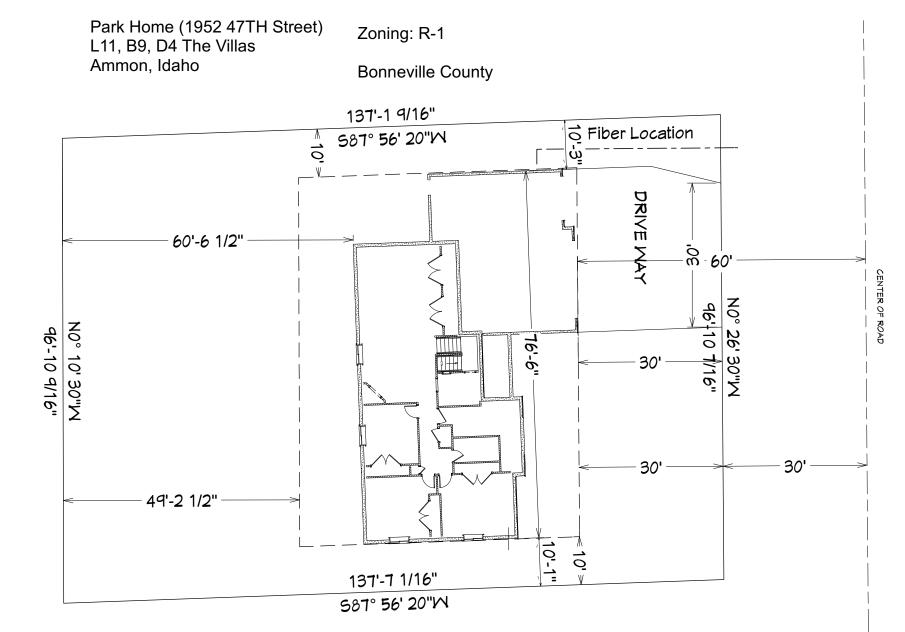

Contractors/Sub-Contractors to verify all finish work with contract. Plans as drawn may represent future options and possible finished layout. Extent of Finish as dictated by Sales Contract supersedes drawing representations.

copyright © Crookston Custom Designs 6/11/2021

	No. Description 1 Construction Set 3 Construction Set 4 Construction Set
N ATTH STREET	copyright © Crookston Custom Designs 6/11/2021 F PRAVINGS ARE NOT STAMPED AND SIGNED THEY ARE TO BE CONSIDERED PRELIMINARY NOT FOR CONSTRUCTION OR PRELIMINARY NOT FOR CONTACT CROOKSTON CUSTOM DESIGNS.
	Main floor: 1798 sf Foundation: 1766 sf Basement finished: 1426 sf I300 Etat 2500 North North Logen, Utab 83.41 North Logen, Utab 83.41 Star Star Star Star Star Star Star Star
	Statistics SCALE: 12225 1" = 10' Professional Stamp For Structural Design Only SHEET: